

**T210-PC**

FM Approved and CSA Certified Class I Div. 2 power connection kit for use with any wattage B, N, J, or P tracer. Includes junction box and bundle mounting bracket with adjustable straps. Junction box also includes surface mounting feet.

**T9310-PC**

Approved to CENELEC standards for hazardous area locations. Use with any wattage P, MN and N15 or N20 tracers. Installs in customer supplied junction box with M25 hub.

**TPC1**


CSA Certified Class I Div. 1 power connection or end termination kit for use with any wattage B, N, J or P tracer. Installs in customer supplied junction box with 1/2" npt hub.

TERMINATION KITS

TRACEPAK




T210-ET

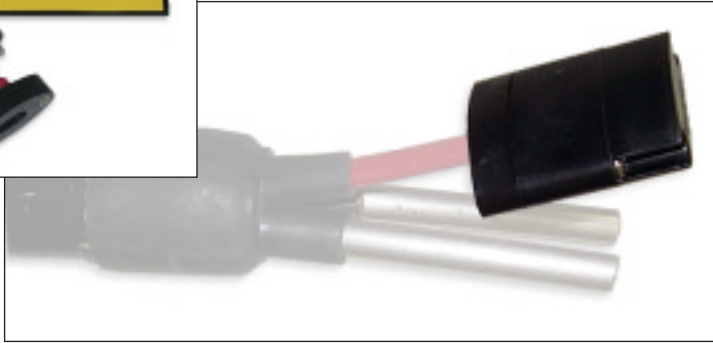

FM Approved and CSA Certified Class I Div. 2 termination kit for use with any wattage B, N, J or P tracer.




T310-ET10

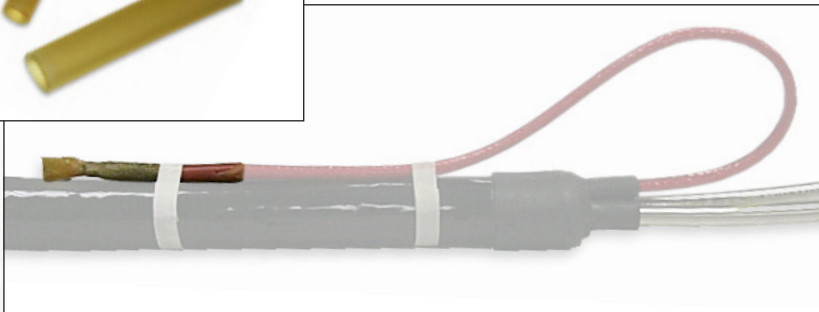

Approved to CENELEC standards for hazardous area locations. Use with any wattage P tracer.



T310-ET13

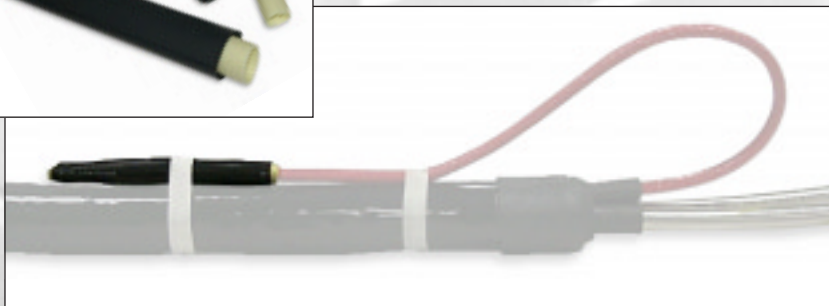

Approved to CENELEC standards for hazardous area locations. Use with any wattage MN and N15 or N20 tracers.

Specifications subject to change without notice.